

ABOVE GROUND POOLS - RULES & REGULATIONS

Permit Number (Completed by Village) _____

Applies to:

- Replacement of existing Above Ground Pools or Installation of new Above Ground Pools

This is a Temporary Structure of 20" or higher of water. Pool will be disassembled by _____

Fees: (Found in Village Code, Title 5, Chapter 2)

- \$60 Pool Permit
- \$60 Fence Permit, if applicable, see below.
- Variable Fees, Electrical Permit, if applicable, see below.

Pool Permit Required:

- Only allowed in rear yard, minimum of 10 feet from side & rear lot lines
- Not allowed on easements
- Plat of survey required
- Recommended 5 feet distance from all other structures, but not less than 4 feet.

Fence Permit Required: (Unless existing fence meets code requirements)

Ground Yard Fence: \$60 Fence Permit

- At least 5 feet high
- Gates to be self-closing & latching
- Latches to be 4 feet above grade or otherwise made inaccessible from outside

Around Top of Pool: No Charge Permit

- At least 5 feet above grade
- Ladder that locks in "up" position OR a deck with a landing accessible by stairs from the yard with a gate to the pool that is to be 5 feet high with guardrails on both sides of the gate that are 5 feet wide and 5 feet high.
- Latches to be 4 feet above grade or otherwise made inaccessible from outside of pool
- Elevated decks around pools need 36" high guardrails (4" maximum openings)

Electrical Requirements: Will any accessories of this pool require electricity? Yes No If Yes, New Existing

Note: All new electric requires an additional Electrical Permit Application.

- Underground wiring shall not be permitted under or within 5 feet of pool
- Overhead conductor clearance shall not be permitted within 10 feet of pool
- See page 2 for Ground Fault Interrupter Requirements
- Equipment must be located outside of required side setbacks.

Additional Requirements:

- That if any part of pool structure, pool deck, or required fencing encroaches on a designated easement and damage results when the easement is used for its permitted purposes, repair of said damage is the sole responsibility of the home owner.
- That you are responsible for any covenants your subdivision may have regarding pools.
- Above ground pools buried more than 12" in ground require further review

Application must meet one of the following requirements or permit will not be issued:

- New fence and/or deck to be installed meeting above requirements – permit issued.
- Existing fence already meets above requirements.

The undersigned hereby applies to the Development Services Department of the Village of Orland Park, IL for a permit to erect, alter, construct, or enlarge the structure or part thereof herein described, and if granted the permit applied for I will comply with all requirements of the village ordinances relating thereto and pay the fees required by such ordinances. I have read and understand terms, conditions and requirements listed on this handout.

Print Applicant Name	Signature of Applicant	Date
----------------------	------------------------	------


ABOVE GROUND POOLS - RULES & REGULATIONS



Permit Number (Completed by Village)

TYPICAL SITE PLAN (EXAMPLE ONLY)

All existing structures & proposed structures applied for under permit must be drawn on copy of survey/site plan.

Copy of completed survey must be submitted with permit application.

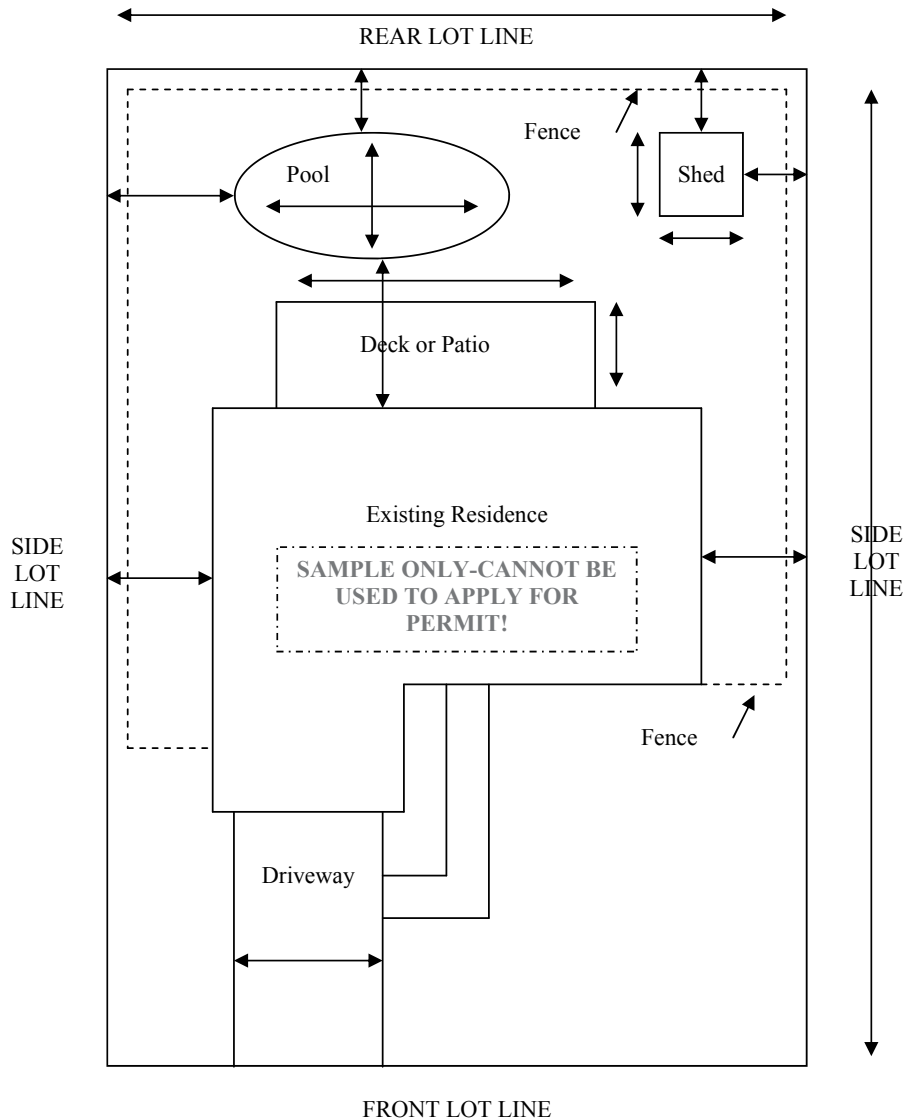

Include all dimensions where  lines are shown.
 Example: 

ABOVE GROUND POOLS - RULES & REGULATIONS

Permit Number (Completed by Village)

Ground-Fault Circuit Interrupters Required

All electrical equipment, including power-supply cords, used with storable pools shall be protected by ground-fault circuit interrupters.

A storable pool may be readily disassembled and has a maximum wall height of 42 in. Pools of any dimension with inflatable walls are considered storable. See the definition of storable swimming or wading pool in Section 680-4. (2011 National Electrical Code w/ Amendments, Village Code Title 5 Chapter 3). This type of pool and its associated equipment does not require bonding conductors. However, the filter pump is required to be double insulated, and grounding means consisting of an equipment grounding conductor that is an integral part of the flexible cord is required to be provided. There are portable filter pumps for use with storable pools listed by Underwriters Laboratories Inc.

The receptacle is required to be located at least 10 feet from the pool (see Section 680-6(a)), and all electrical equipment is required to have ground-fault circuit interrupter protection for personnel. See Figure 680.16 on the next page for the requirements for a storable-type pool.

680-32 Lighting Fixtures

15 Volts or Less. A lighting fixture installed in or on the wall of a storable pool shall be part of a cord-and-plug-connected lighting assembly. This assembly shall be as follows:

- Have no exposed metal parts
- Have a fixture lamp that operates at 15 volts or less
- Have an impact-resistant polymeric lens, fixture body, and transformer enclosure
- Have a transformer meeting the requirements of Section 680-5(a) with a primary rating not over 150 volts, and
- Be listed as an assembly for the purpose

Not Over 150 Volts. A lighting assembly without a transformer, and with the fixture lamp(s) operating at not over 150 volts, shall be permitted to be cord- and plug- connected where the assembly complies with all of the following.

- It has no exposed metal parts
- It has an impact-resistant polymeric lens and fixture body
- A ground-fault circuit interrupter with open neutral protection is provided as an integral part of the assembly
- The fixture lamp is permanently connected to the ground-fault circuit interrupter with open-neutral protection.
- It complies with the requirements of section 680-20(a)
- It is listed as an assembly for the purpose

ABOVE GROUND POOLS - RULES & REGULATIONS

Permit Number (Completed by Village)

Section 680-32(b)(6) recognizes lighting fixtures installed in or on storable pools. It should be understood that these cord and plug connected fixtures are required to be listed as an assembly.

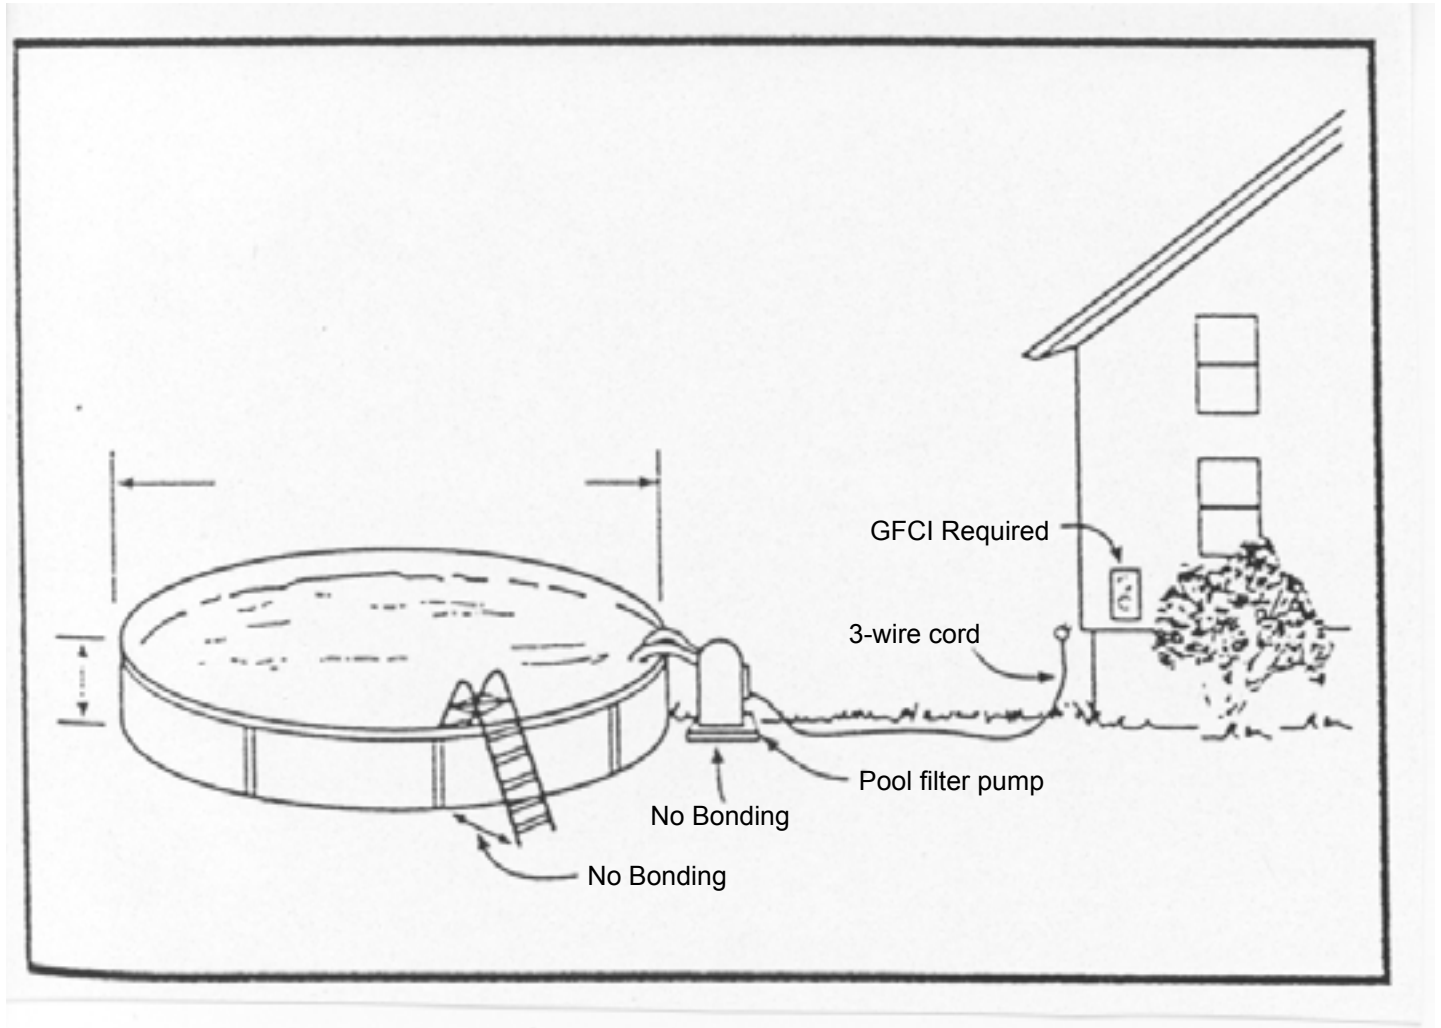


Figure 680.16 The requirements for a storable-type pool. Metal appurtenances are not required to be bonded. The 3-wire cord may be longer than 3 ft. (Some listed filter pumps are equipped with cords 25 ft. long.) The receptacle shown can be a GFCI-type receptacle, a receptacle supplied through a GFCI-type receptacle, or a receptacle protected by a GFCI-type circuit breaker.

FPN: Where flexible cords are used, see Section 400-4.